

EMERGENCY ACCESS REQUIREMENTS

HIGH - RISE BUILDINGS

THE FOLLOWING IS A LIST OF EMERGENCY ACCESS REQUIREMENTS ON YOUR PROPERTY.

PLEASE VISIT OUR WEB SITE FOR A COMPLETE BOOKLET OF DETAILS FOR YOUR SITE.

www.phoenix.gov/fdaccess

Address Requirements:

- Address numbers on commercial buildings shall be a minimum of 12 inches high with a minimum 2 inch brush stroke on contrasting background.
- When buildings are more than **200 feet long** or set back from the road **more than 100 feet**, they shall be identified with building address numbers that are a minimum of **24 inches high with a 4 inch brush stroke** of a contrasting color.
- Building address shall be visible from all accessible directions.
- Suite numbers are required for multi tenant complexes and shall be located over the front door and on the rear door with 6 inches high by 1 inch brush stroke on a contrasting background.

Lock Boxes (Knox Box):


- Knox boxes shall be provided for Fire Department access in the following locations:
- A 4400 series dual keyed Knox box shall be provided at the front entry of the structure in a location visible from the fire apparatus road between $5\frac{1}{2}$ - 6 feet above grade.
- If fire riser room, fire command center, or other fire protection equipment is accessible by a separate door a 1658 model Knox box shall be provided between $5\frac{1}{2}$ - 6 feet above grade.
- The fire command center shall have a key cabinet installed for storage of the building keys to support fire operations.

Fire Lanes:

- Approved fire lane marking and signs shall be in accordance with Chapter 5 of the Phoenix Fire Code. See *fire lane figures available on our web site*.

Identification of Fire Protection Equipment:

- Fire department connections, riser rooms, fire pumps, standpipes and fire alarms shall be clearly identified.
- Fire Command center shall be identified by permanent easily visible sign noting "Fire Dept. Command Center" located on the door of fire command center. See *fire figures available on our web site*.

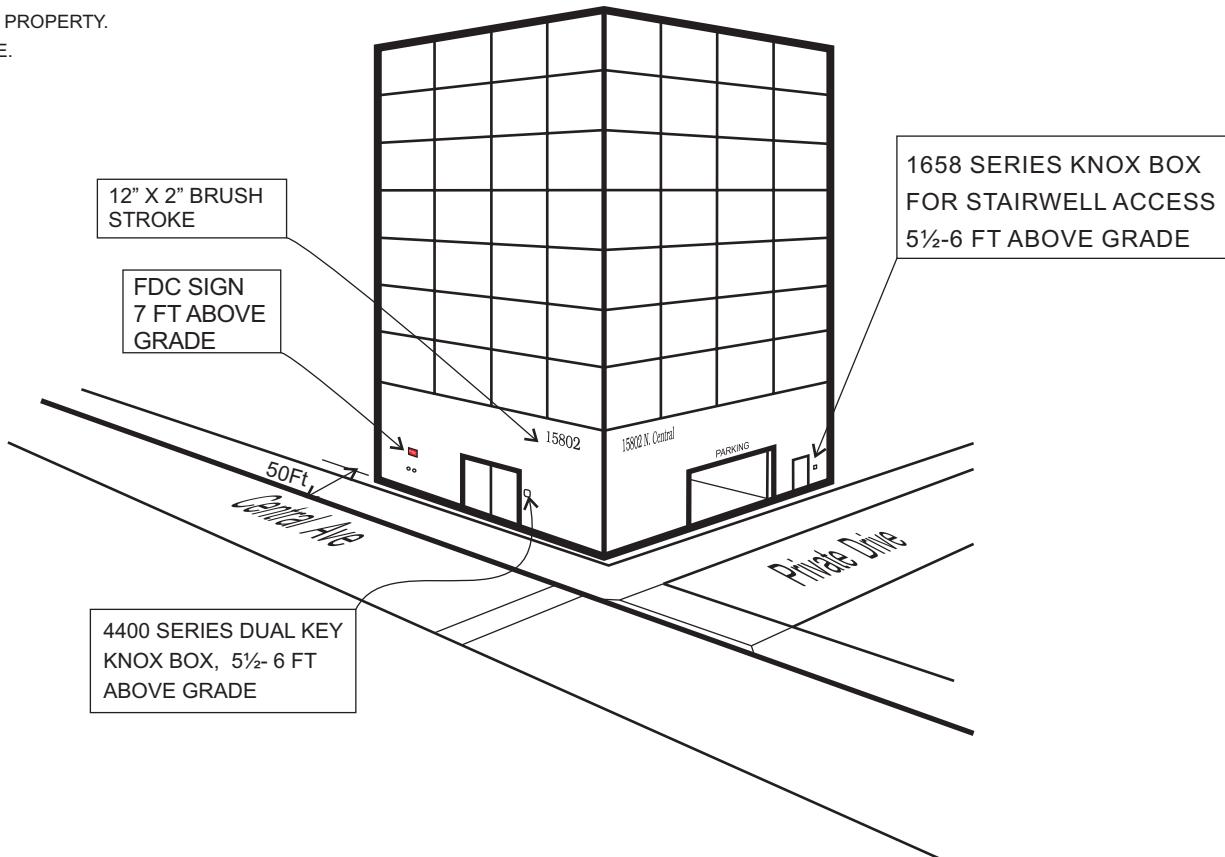

Stairwell Floor Number Signs:

- Approved stairwell signs shall be provided in accordance with Chapter 5 and Chapter 10 of the Phoenix Fire Code. See *stairwell sign figures available on our web site*.

Marquee and Monument:

Addresses installed on a marquee or monument located next to the street will require numbers 12 inches high by 2 inch brush stroke.

- Located a minimum of 3 feet above grade.
 - Numbers shall contrast with the background.
- See *addressing figures available on our web site*.

Gates:

- All vehicle access gates (electric or manual) are required to have a separate gate permit. See *steps to get gate permit and available details on our web site*.

Phoenix Fire Department
150 South 12th Street
Phoenix, Arizona 85034

