

STANDARD DETAIL W-317

CITY OF PHOENIX, ARIZONA
 WATER SERVICES DEPARTMENT
 DISTRIBUTION & COLLECTION ENGINEERING DIVISION

Q.S. _____


KIVA _____

MULTIPLE WATER SERVICE CONNECTION INSTALLATIONS

APPROVED *James D. Conway*
 WATER SERVICES DEPARTMENT


DATE December 27, 2007

NOTE: APPROVED BACKFLOW PREVENTER IS REQUIRED ON CUSTOMER SIDE OF EACH WATER METER AND IS TO BE INSTALL BY PROPERTY OWNER AT HIS EXPENSE AS PART OF THE PRIVATE PLUMBING SYSTEM.

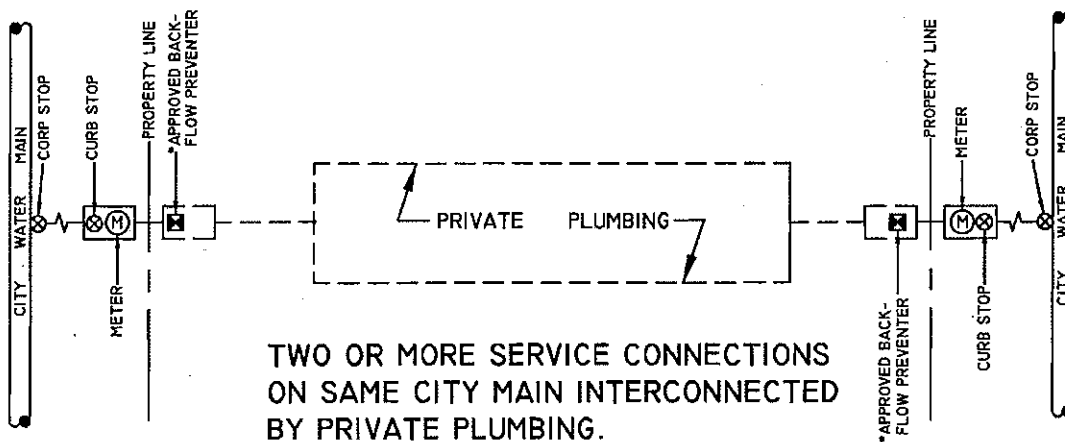

TWO OR MORE SERVICE CONNECTIONS ON SAME CITY MAIN INTERCONNECTED BY PRIVATE PLUMBING.

* APPROVED PER PHOENIX PLUMBING CODE 37-144(27)

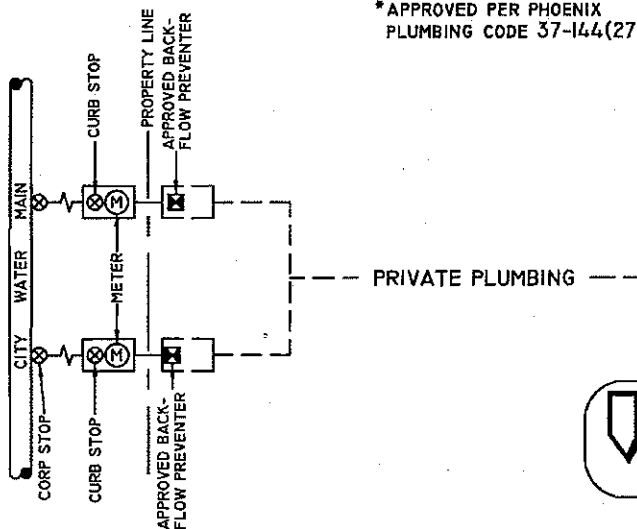

DATE _____

PROJECT NAME _____

ADDRESS _____

DEVELOPERS ASBUILT CERTIFICATION
 I HEREBY CERTIFY THAT THE 'RECORD DRAWING' MEASUREMENTS AS SHOWN HEREON WERE MADE UNDER MY SUPERVISION OR AS NOTED AND ARE CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

TWO OR MORE SERVICE CONNECTIONS ON SAME CITY MAIN INTERCONNECTED BY PRIVATE PLUMBING.

